

Description of TICA Central Air Conditioning Centralized Control System

Option 1:


Centralized Control by OCPAD device



Software	Build-in
Max.Capacity	64 IDUs
Connect	RS 485 port (Two Core Wire)

Option 2:


Centralized Control by Computer software

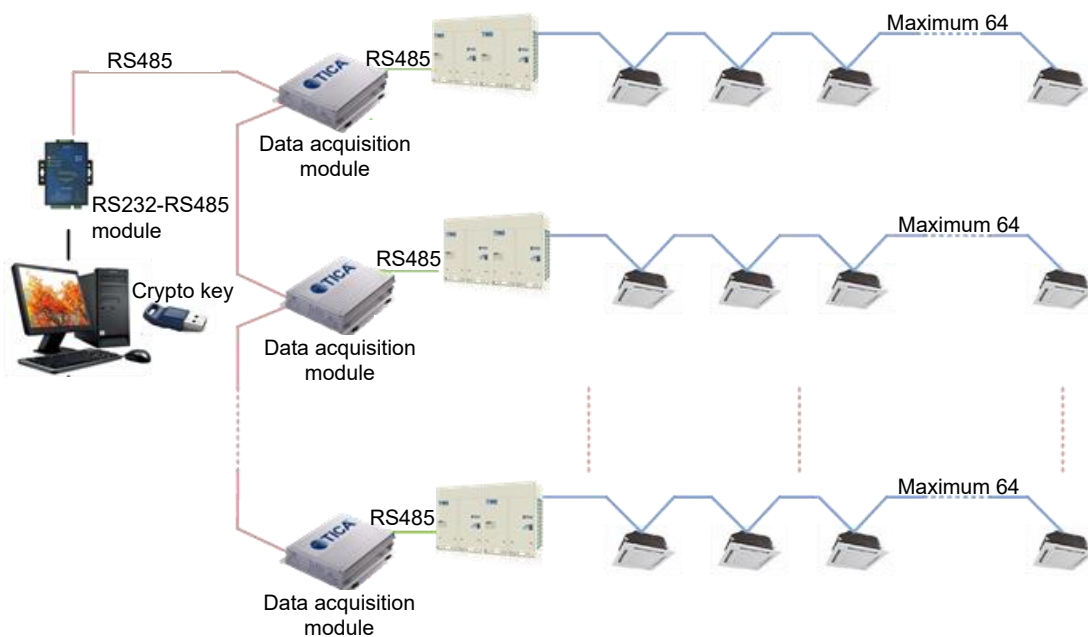

Max. Capacity	2048 IDUs
Requirement	Description
Software	By TICA (charge additional)
Data acquisition module	By TICA(charge additional)
Protocol converter	By TICA(charge additional) RS232 to RS485
Repeater	Optional by TICA(charge additional) Needed when PC to ODUs over 100m
Encrypted USB	By TICA(charge additional) Work with Software

Option 3:

Centralized Control by BMS(Building Management System)

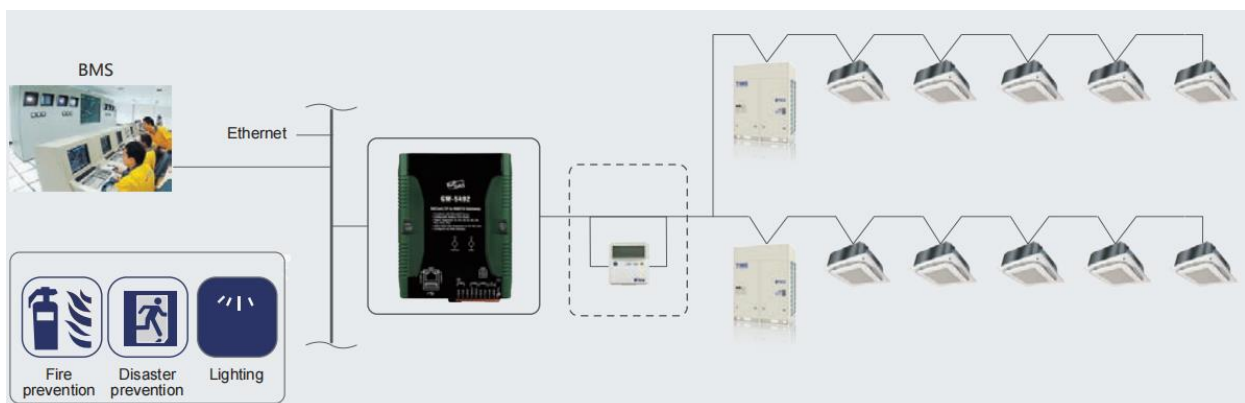

Requirement	Description
BMS Software	By Project/Building Owner
Gateway Device	By TICA(charge additional) ModBus protocol Gateway



TICA PRO LLC

Tel.: +7 495 127 79 00,
+7 915 650 85 85,
+7 969 190 85 85

E-mail: info@tica.pro

[**www.tica.pro**](http://www.tica.pro)

Note: Due to constant improvement and innovation of TICA's products, the product models, specifications and parameters contained in this document are subject to change without prior notice.